



UNIT HEATER SCHEDULE										
UNIT NO.	LOCATION	MBH	AIR DATA			WATER DATA				
			CFM (H)	TEMP. F	EXT. S.P. (H.W.G.)	GPM	TEMP. F	ENT.	L.V.G.	M.P. (H)
UHI-12	GENERATOR BUILDING	108	2010	80	108	-	-	-	-	-

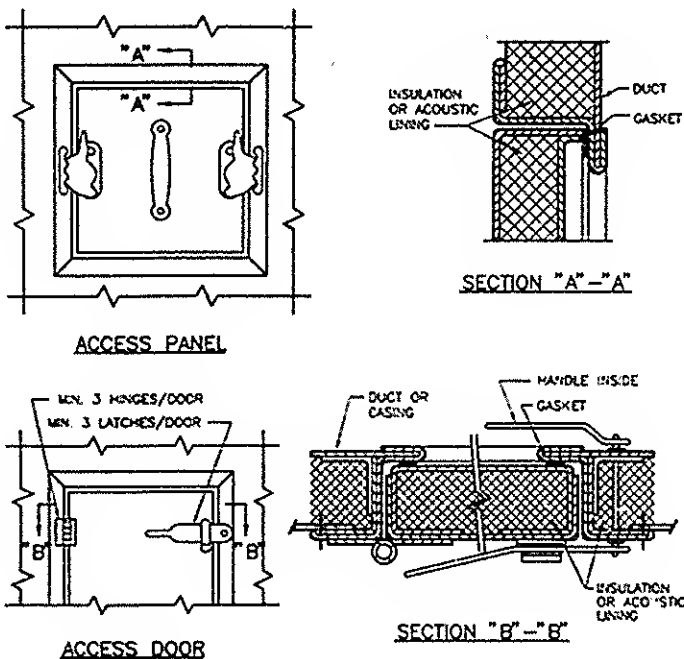

- NOTES:**
1. LATCHES SHALL BE OF THE WEDGE TYPE TO CLOSE DOORS TIGHTLY.
 2. HINGES ON THE ACCESS DOORS SHALL HAVE NON-CORROSIVE PINS.
 3. PROVIDE ACCESS DOORS ON AIR HANDLING UNITS AND DUCT WORK INSTALLED IN EQUIPMENT ROOMS. PROVIDE ACCESS PANELS ON ALL EQUIPMENT AND DUCTWORK INSTALLED ABOVE FINISHED CEILINGS WHERE SPACE LIMITATIONS DO NOT ALLOW HINGED DOORS TO OPEN.
 4. ACCESS DOOR INSTALLED IN THE DUCT EXPOSED TO WEATHER TO BE WEATHERPROOF. ALL HARDWARE SHALL BE STAINLESS STEEL.

ACCESS DOOR & PANEL DETAILS
(NOT TO SCALE)

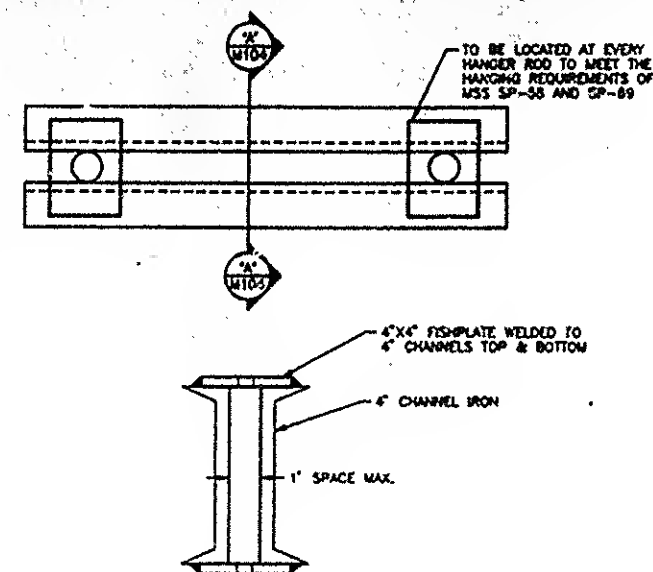